

## Minimum Requirements for GoT HoMIS Installation in Regional Referral Hospitals

S/N	Department	Min. Points	Computers	Printers	UPS	Mobile Device
1	Medical records	1	1	1		
2	Cashier windows	1	2 (1 each point)	2		
3	OPD clinics	4	4 (1 each point)			
4	Specialists OPD	8	8 (1 each point)			
5	Bima clinic	3	3 (1 each point)			
6	IPD	10	10 (1 each point)			10(tablets)
7	Laboratory	7	7 (1 each point)			
8	Radiology	3	3 (1 each point)			
9	Casualty	1	1			
10	Injection Room	1	1			
11	Dressing Room	1	1			
12	Theatre-Main	1	1			
13	Minor Theatre	1	1			
14	ICU	1	1			
15	Physiotherapy	1	1			
16	Dental	1	1			
17	Eye	1	1			
18	Pharmacy-Main Store	1	1	1		
19	Pharmacy-Sub Store	1	1	1		
20	Dispensing-General	1	1	1		
21	Dispensing Bima	1	1	1		
22	Mortuary	1	1			
23	Store-General	1	1			
24	Shift Supervisor (supervision)	1	1			
25	Laundry	1	1			
26	Inv. Management	1	1			
27	CSSD	1	1			
<b>Administration</b>						
28	Registry	1	1			
29	Health Secretary	1	1			
30	Patron/Matron	1	1			
31	Medical Officer I/C	1	1			
32	Hosp. Accountant	1	1	1		
33	CTC	1	1			
34	Vital Sign Stations(OPD)	6	1 each point			

Network						
35	Wireless Aps	6				
36	Network Switch	1	1 (24 ports)			
37	UTP Cable(Cat 6/Cat 5e)	2 rolls				
38	Drop Cable	Depends on number of Connected devices				
39	RJ 45	1 Packet				

Table1: The minimum requirement for the full GoT-HoMIS installation

**NB:**

Health facilities are advised to discuss with their Regional ICT Officers/District ICT Officers, Electrical Technicians on the network/LAN implementation as well as the power backup plan.

We also recommend the Regional/District ICT Officers to go for *N-computing* (Thin client technology) because the devices are very cheap on the market.

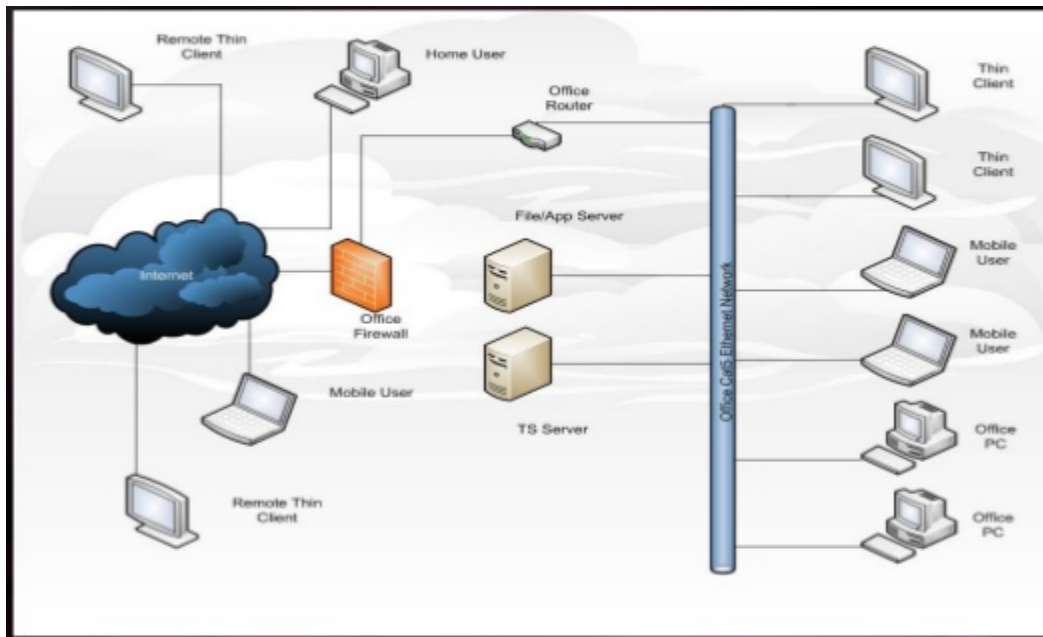


Figure1: Basic thin client architecture.

**Note:**

Health facilities can choose from the table above all the departments that they have and implement LAN ready for the GoT HoMIS deployment.